



417th BSB (KITZINGEN)
SPILL PREVENTION, CONTROL, AND COUNTERMEASURES PLAN

The Red Plan

In the event of a spill of a hazardous substance or hazardous waste at installations of the 417th Kitzingen BSB, this Red Plan serves as an immediate action tool to get the correct response initiated at the earliest possible time. The remainder of this SPCC Plan reinforces the Red Plan and provides in-depth information on spill prevention, response, notification, and cleanup procedures. The Red Plan is to be used in the early stages of a spill and the user is expected to transition to the remainder of the SPCC Plan after appropriate notifications and response actions are underway.

February 2002 (update Aug 03)

Initial Spill Responder Action List

If it's a minor spill, clean it up now.

A minor spill does not:

- enter or threaten waters,
- exceed a reportable quantity, or
- pose a safety or environmental threat.

If it's not minor, do the following.

1. Report the Spill.

Call installation or BSB Fire Department if on-post, or call German Fire Department if off-post.

Report the following:
Initial responder name and location.
Time, location, type/quantity of spill.
Need for emergency medical assistance.

2. Determine Safe Actions.

No safe actions may be possible.

What is it, how can it hurt me, and what can I safely do?

Check MSDS for material spilled.
Take safe, no-contact simple actions that may help victims, help threatened

3. Stop the Leak.

Don't contact or breathe vapors from material.

Close valves, stop pumps, shut down power, move containers.

4. Control and Contain.

Keep the spill from spreading.

Close containment valves.

Put portable containments down.

Put absorbents down.

Emergency Response Team Action List

Follow the Spill Plan.

- Notify authorities.
- Obtain personnel and equipment.
- Determine installation/unit information.

Determine Safe Actions.

- Evaluate material, hazards, evacuation needs.
- Obtain/check MSDS for material spilled.
- Determine extent, migration, weather.
- Provide personal protective equipment.

Rescue and Evacuate.

- Determine threatened areas and populations.
- Determine safe distances, safe refuge, evacuation routes.
- Activate evacuation personnel and provide for medical treatment needs.

Protect Humans and Animals.

- Suppress airborne hazards-vapors, gas, dust.
- Notify affected workers, residents.
- Control access to the spill site and threatened areas.

Prevent, Control and Suppress Fire and Explosions.

- Assess existing/potential fires or explosion hazards.
- Exercise caution with POLs and flammables.
- Control ignition sources and fuels.
- Properly handle fire water runoff.

Set Water and Environmental Protection Priorities.

- Protect drinking water resources.
- Protect wastewater treatment plants.
- Protect critical or sensitive ecological areas.


Prevent Material Spread.

- Stop or slow the release.
- Set up containments, diversions, and surface impoundments.
- Transfer materials to safe storage.
- Keep spill from reaching sewers.

Address Non-critical Priorities.

- Recover the bodies of human and animal victims.
- Recover property and equipment in immediate danger.
- Prevent property and equipment damage.
- Dispose of spilled materials.

Initial Spill Response and Notification

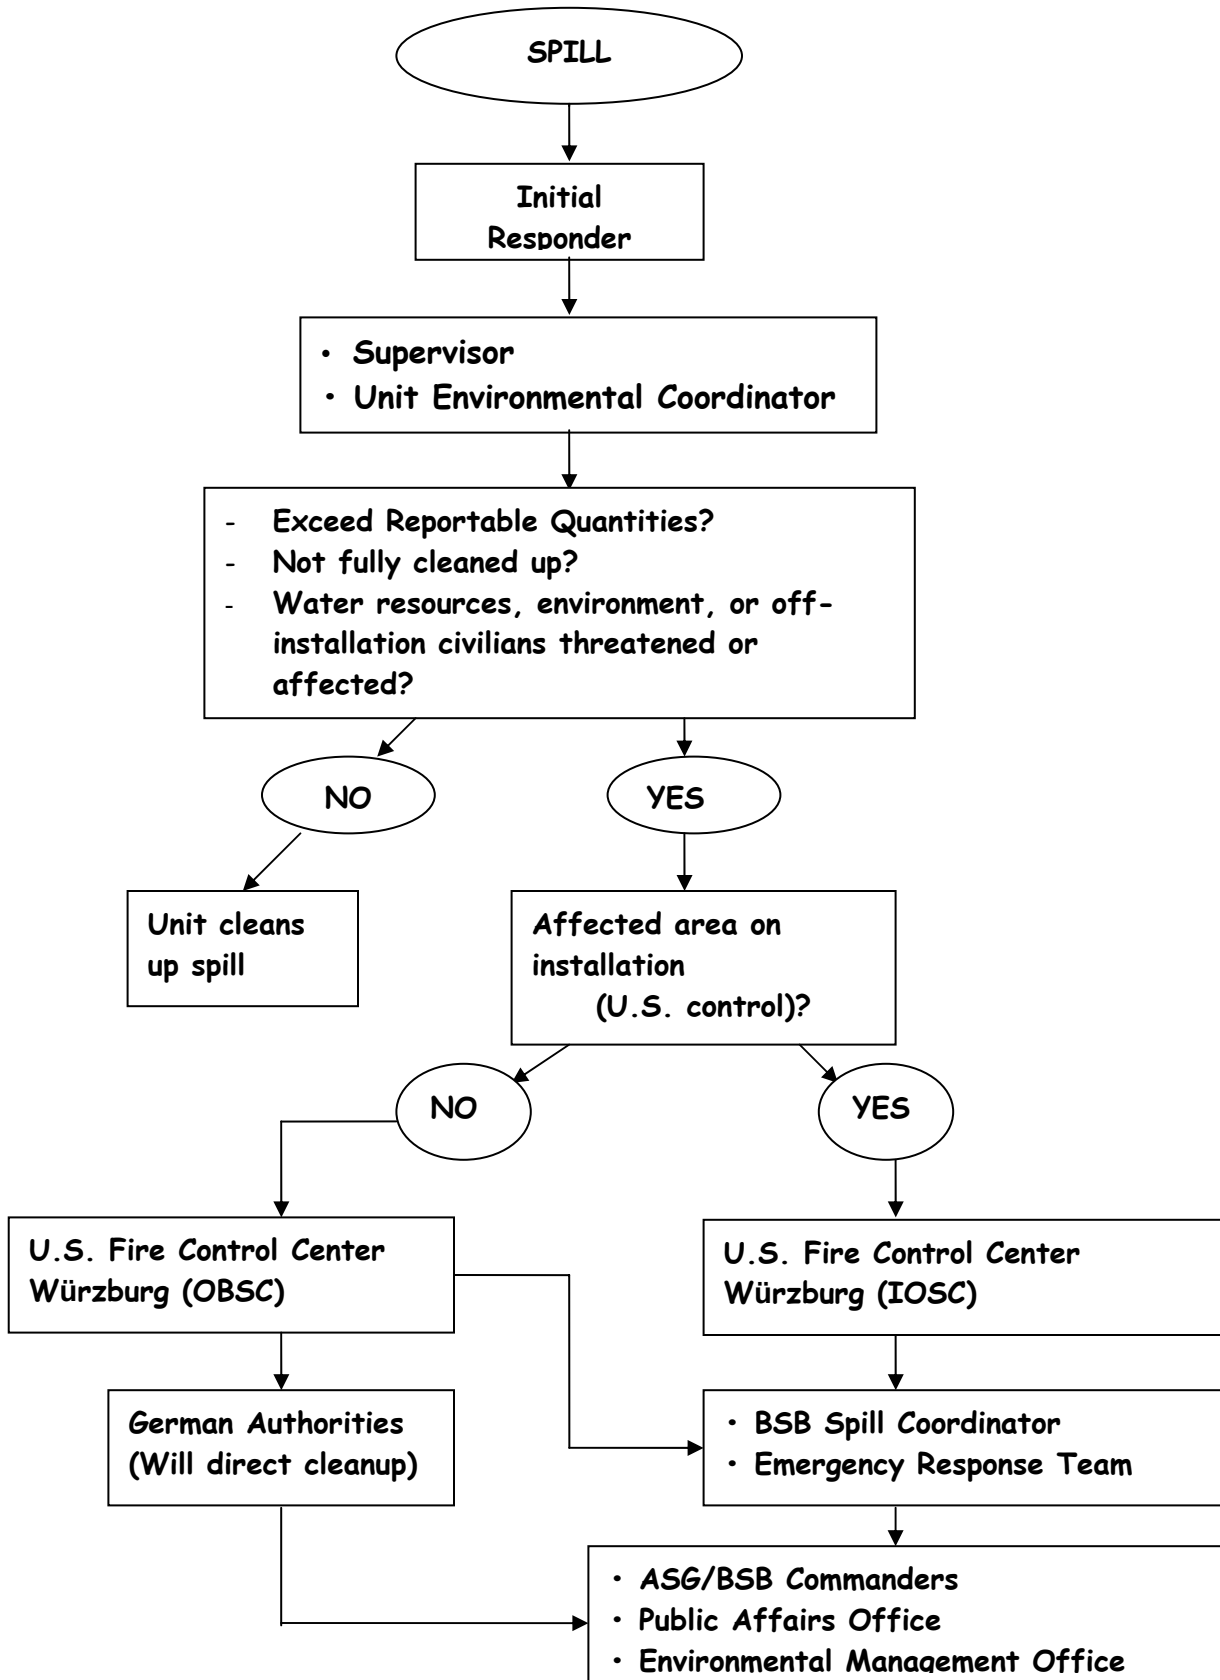

POINTS OF CONTACT

The following personnel and organizations are POCs which may need to be contacted in the event of an HS or HW spill at the 417th BSB:

| Position/Title | Name of Individual | Organization/ Mailing Address | Telephone No. (Work) | Telephone No. (Mobile) |
|---|--------------------|--|---|---------------------------|
| BSB Fire Departments | | Fire Control Center ¹ / Fire Station Würzburg | 351-4500 / 4782 / 4239 CIV: 0931-25578 / 0931-296-4500 | |
| | | Fire Station Kitzingen | 355-8773 CIV: 09321- 305- 773 | |
| | | Fire Station Giebelstadt | 352-7239 CIV: 09334-8-7239 | |
| FIRE DEPARTMENT | | EMERGENCY | 117 (DSN) | |
| Military Police | | MP Station Würzburg | 350-6548 CIV: 0931-889- 6548 | |
| | | MP Station Kitzingen | 355-8855 CIV: 09321- 305- 855 | |
| | | MP Station Giebelstadt | 352-7559 CIV: 09334-8- 7559 | |
| Military Police | | EMERGENCY | 114 (DSN) | |
| Emergency Operations Center (EOC) | | | 351-1490 / 4293 CIV: 0931-889- 1490 | |
| U.S. Army Hospital | | 67 th Combat Support Hospital (CSH) Emergency Room, Würzburg | DSN: 350-3877 / 3700 CIV: 0931-804- 3877 / 3700 | |
| German Police | | EMERGENCY | CIV: 110 | |
| German Fire Department | | EMERGENCY | CIV: 112 | |
| German Ambulance | | EMERGENCY | CIV: 19222 | |
| Chief, DPW Environment Management Office AND BSB Spill Coordinator | Gerda Koss | 417 BSB DPW, Unit 26622, APO AE 09244 | 351-4581 / 4421 CIV: 0931-296- 4421 | 0160-9390-9622 |

| Position/Title | Name of Individual | Organization/ Mailing Address | Telephone No. (Work) | Telephone No. (Mobile) |
|--|--|---|---|--|
| Chief, DPW Building and Grounds Division | Achim Ohlenschlager | 417 BSB DPW, Unit 26622, APO AE 09244 | 351-4418 / 4584 CIV: 0931-296-4418 | 0160-9390-9568 |
| Chief, DPW Utilities Division | Peter Bonnet | 417 BSB DPW, Unit 26622, APO AE 09244 | 351-4441 / 4451 / 4600 CIV: 0931-296-4441 | 0160-9390-9600 |
| Chief Facility Engineer, Kitzingen | Guenther Koestner | 417 BSB DPW, Unit 26622, APO AE 09244 | 355-8652 / 8881 CIV: 09321-305-652 | 0160-9390-9638 |
| Facility Engineer, Giebelstadt | Anton Stock | 417 BSB DPW, Unit 26622, APO AE 09244 | 352-7406 / 7354 CIV: 09334-8-7354 | |
| HW Emergency Coordinator² | Gerda Koss Ludger Henning Ludwig Hippler | 417 BSB DPW, Unit 26622, APO AE 09244 | 351-4581 / 4582 or 355-8201 CIV: 0931-296-4581 / 4582 | 0160-9390-9622 0160-9950-7360 0160-9390-9624 |
| ¹ <i>The Fire Control Center serves as both the Installation On-Scene Coordinator (IOSC) as well as the Off-Base Spill Coordinator (OBSC).</i> ² <i>Must be able to contact 24 hours per day.</i> | | | | |